


ADDRESS SHALL BE POSTED AT BUILDING

SECONDARY JUNCTION BOX (NORDIC PSP-151530 MG) OR TRANSFORMER

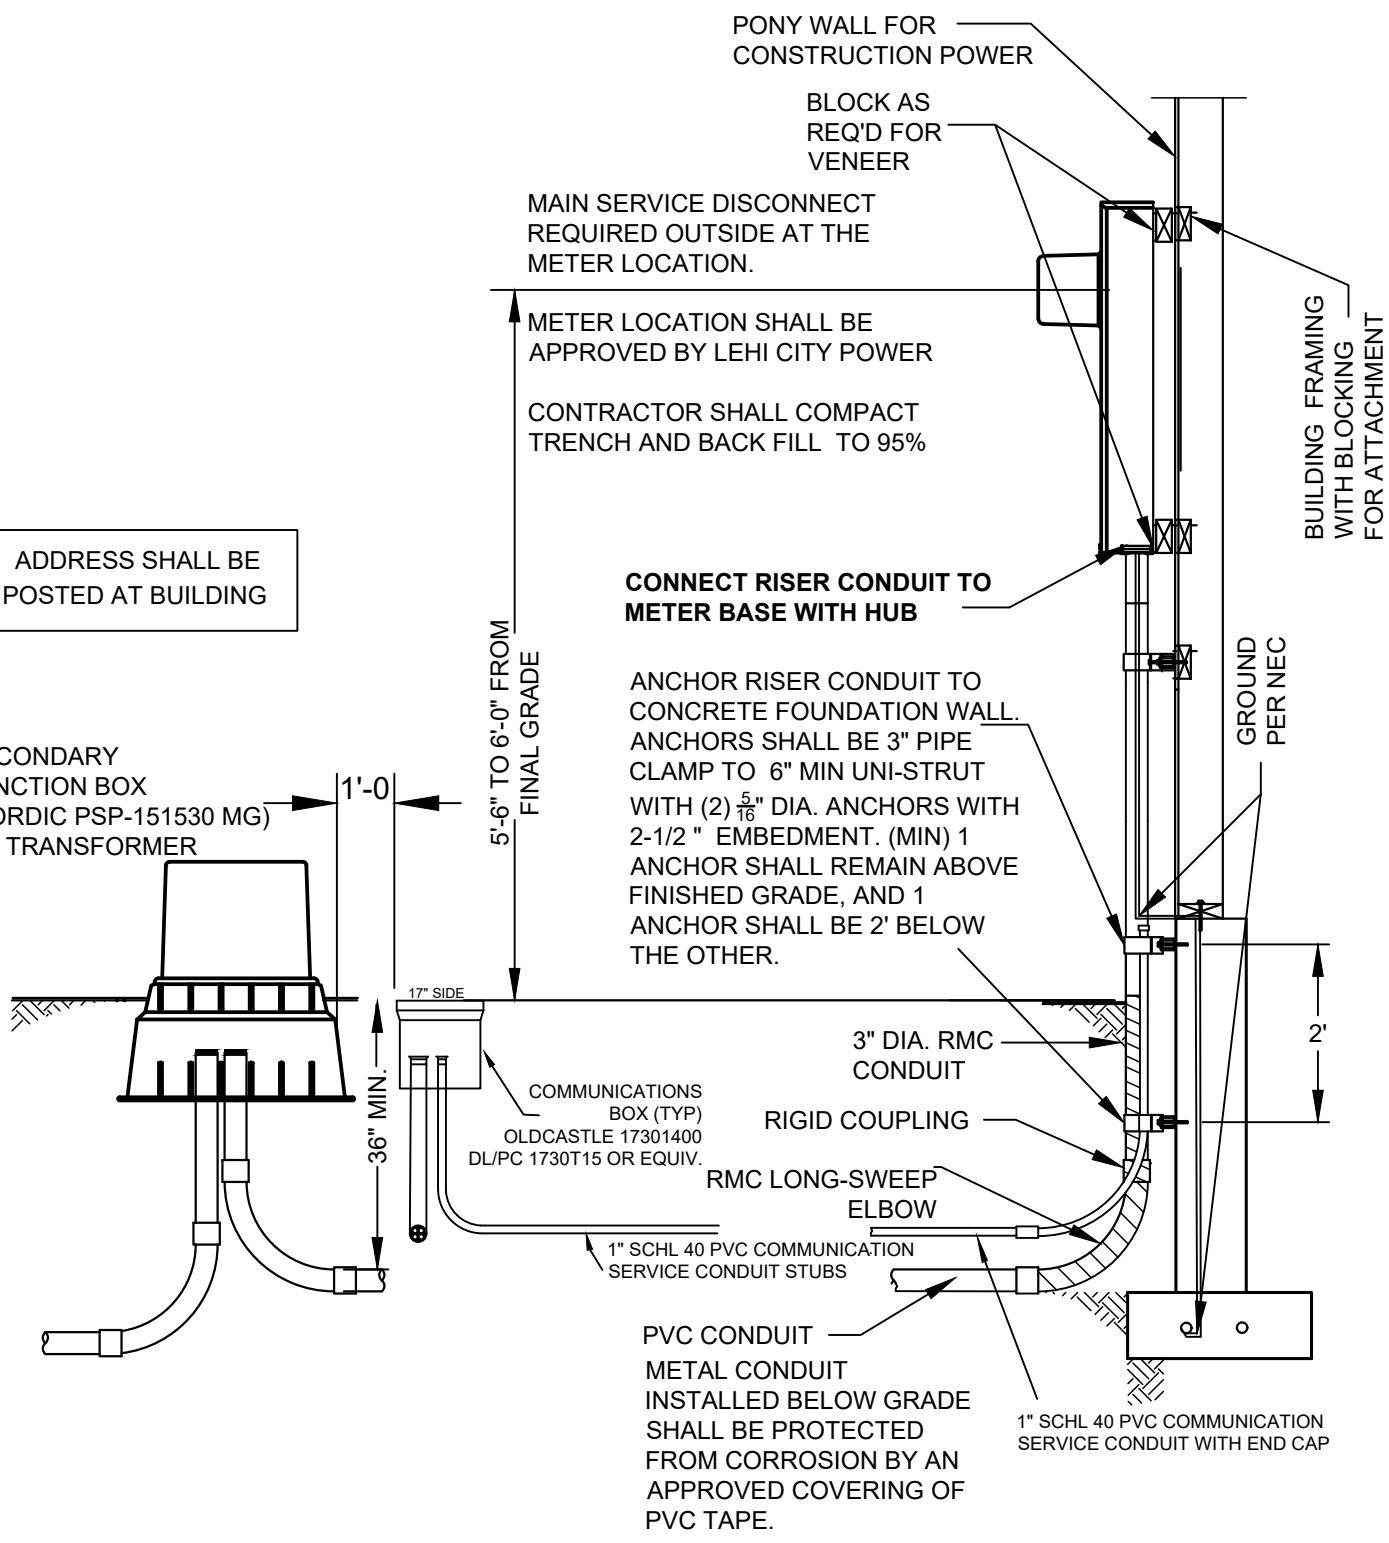

CONNECT RISER CONDUIT TO METER BASE WITH HUB

ANCHOR RISER CONDUIT TO CONCRETE FOUNDATION WALL. ANCHORS SHALL BE 3" PIPE CLAMP TO 6" MIN UNI-STRUT WITH (2) $\frac{5}{16}$ " DIA. ANCHORS WITH 2-1/2" EMBEDMENT. (MIN) 1 ANCHOR SHALL REMAIN ABOVE FINISHED GRADE, AND 1 ANCHOR SHALL BE 2' BELOW THE OTHER.

PVC CONDUIT METAL CONDUIT INSTALLED BELOW GRADE SHALL BE PROTECTED FROM CORROSION BY AN APPROVED COVERING OF PVC TAPE.



**REQUIREMENTS & STANDARDS
UNDERGROUND SERVICE
100-400 AMP (1 PHASE)
CONSTRUCTION POWER SERVICE**

DWG: 3.2.1
REV. 1.00
BY: GWK/BT
DATE: 6/23/20