


FINAL GRADE



NOTES:

1. BEDDING & BACKFILL MATERIAL MUST BE APPROVED BY LEHI POWER
2. INSPECTION REQUIRED PRIOR TO BACKFILL COMPACTION TESTING REQUIRED. REFER TO 4.2.1
3. SERVICE LATERAL DEPTH 36" MINIMUM.
4. PROVIDE BEDDING ON ALL CONDUIT SURFACES AND 6" SEPARATION BETWEEN POWER CONDUITS
5. PROVIDE DEPTH OF 1 FOOT TO TOP OF CONDUIT FOR EVERY 1 INCH OF NOMINAL DIAMETER
6. LEHI POWER REQUIRES A 4-WAY x 16/13MM MICRODUCT TO ACCOMPANY ALL POWER CONDUIT RUNS.

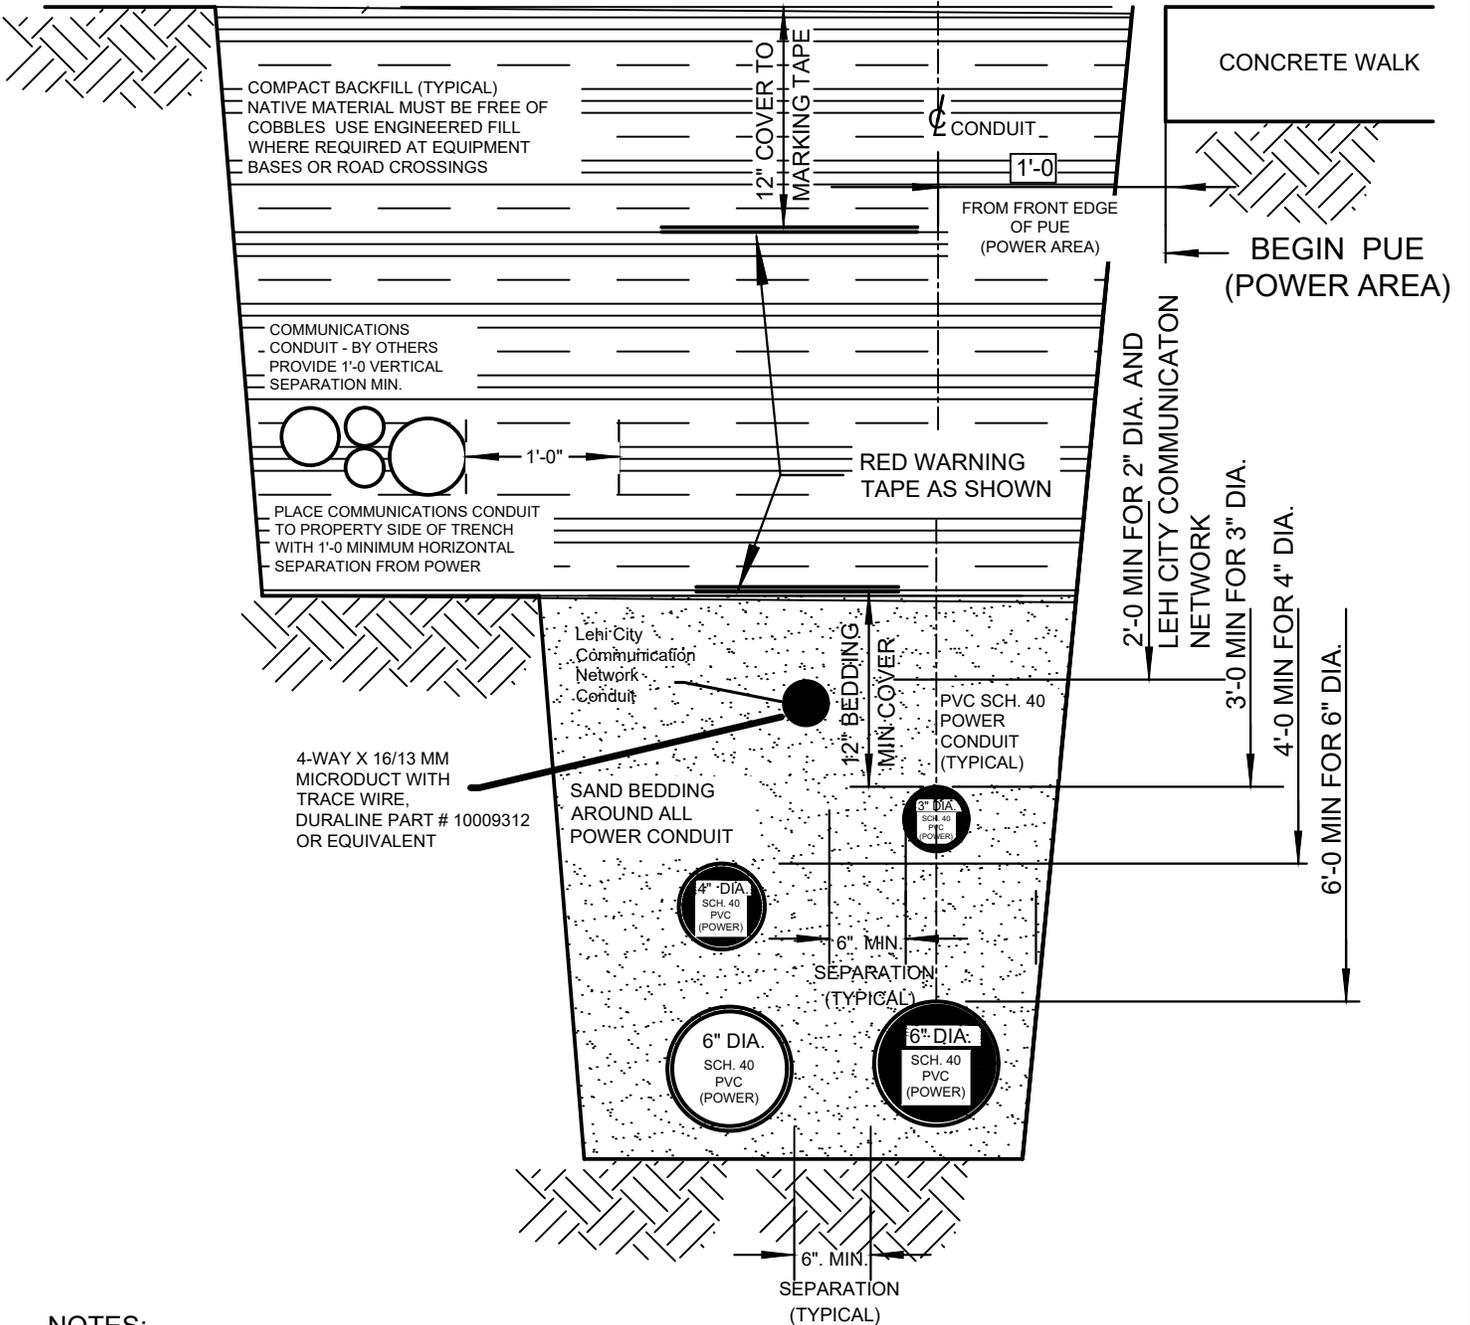

REQUIREMENTS & STANDARDS
POWER TRENCH & JOINT USE TRENCH DETAIL
RESIDENTIAL & COMMERCIAL SUBDIVISION

DWG: **4.2.2**

REV. 1.01

BY:GWK/BT

DATE: 2/14/24